




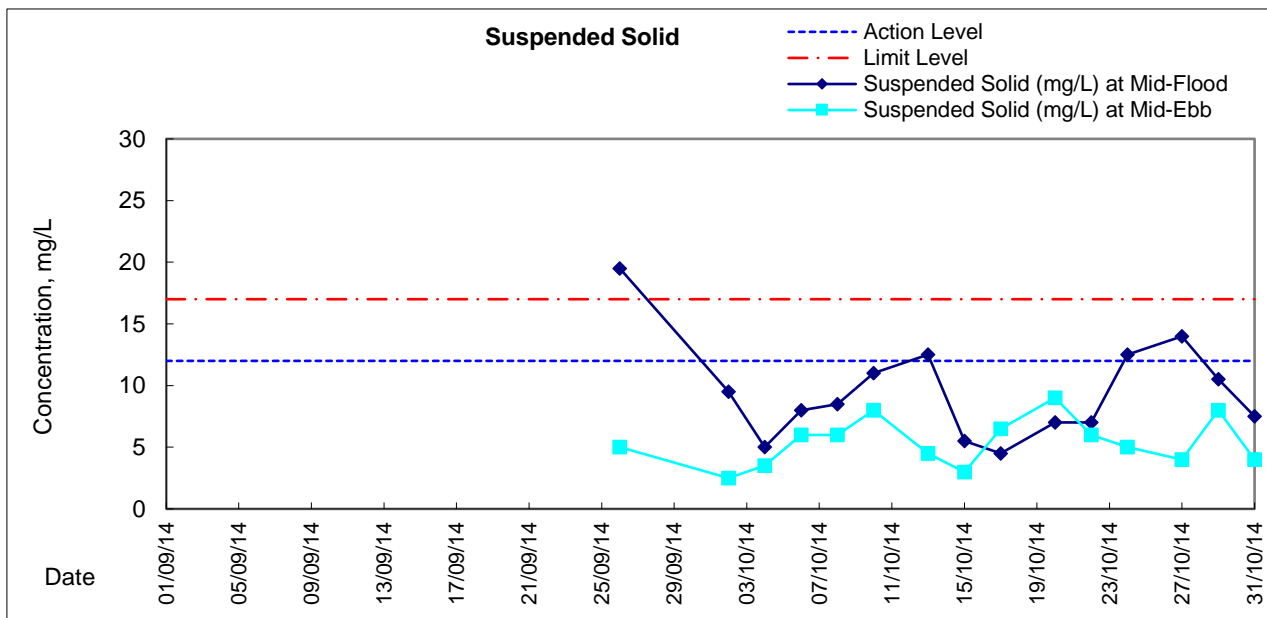

Graphic Presentation of Water Quality Result of M5B - Central Cooling Water Intake Groups

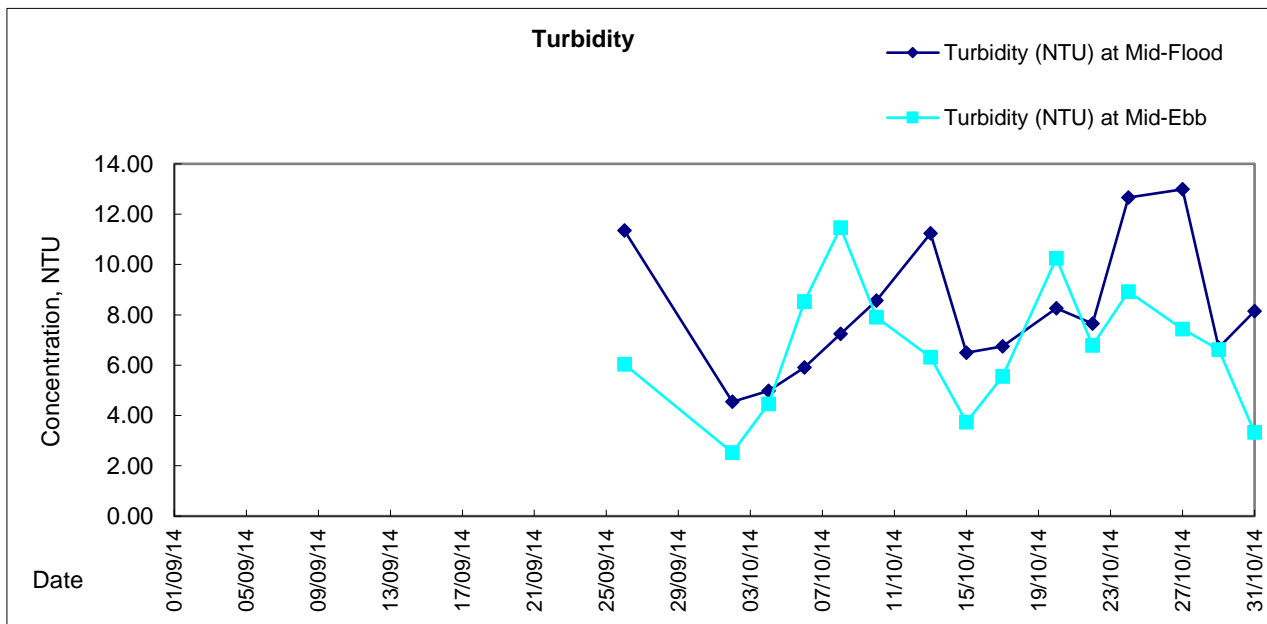

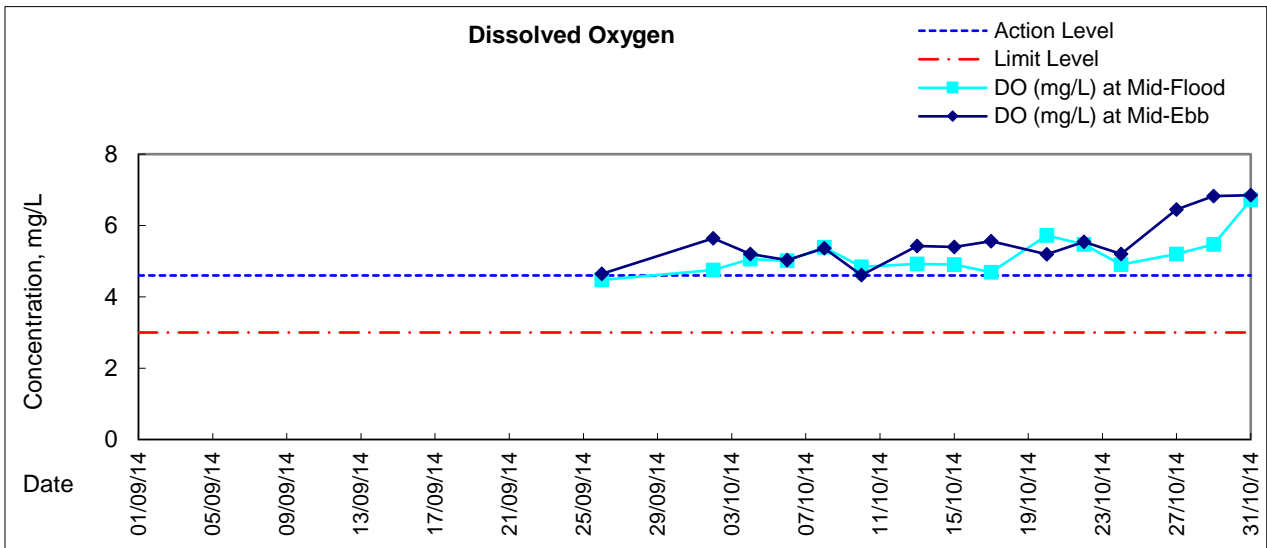

Graphic Presentation of Water Quality Result of Culvert J - Reference Station

