Graphic Presentation of Water Quality Result of M5B - Central Cooling Water Intake Groups

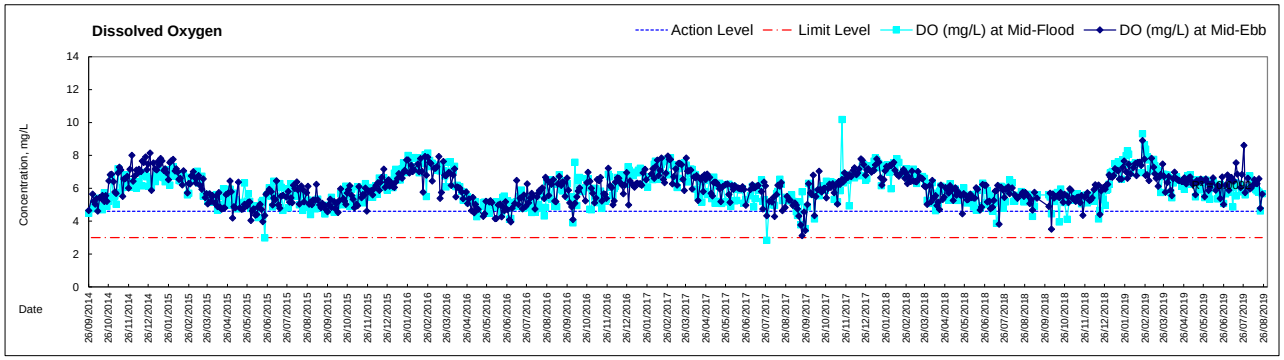

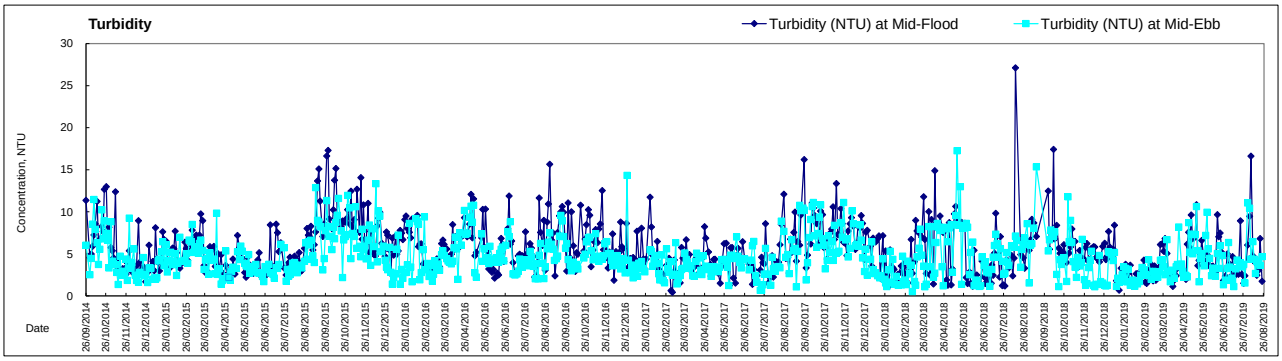

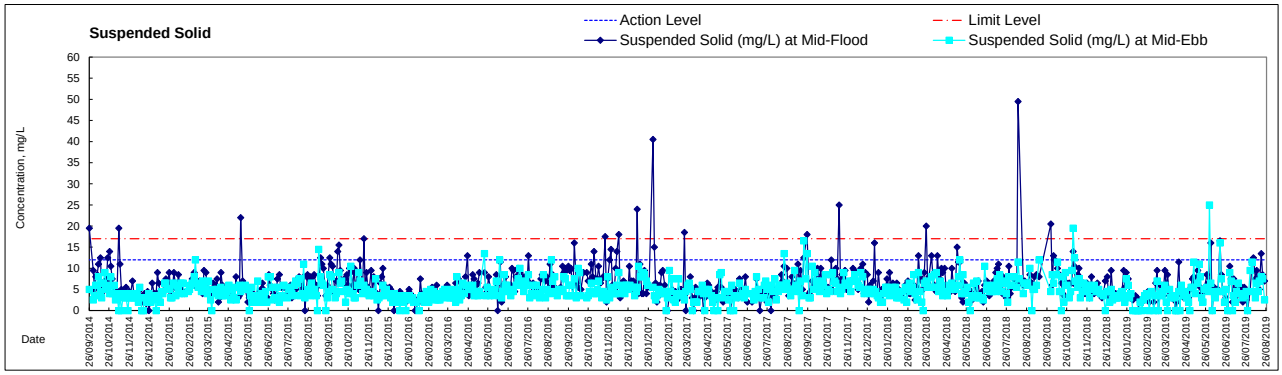
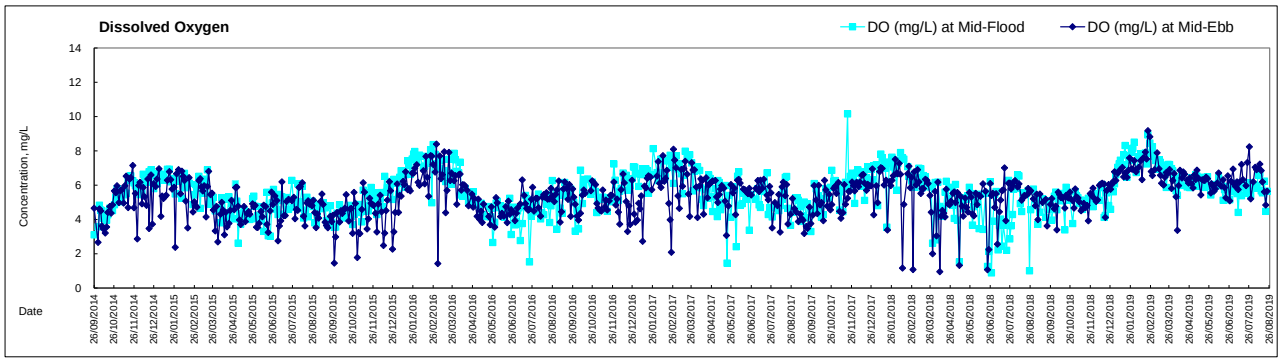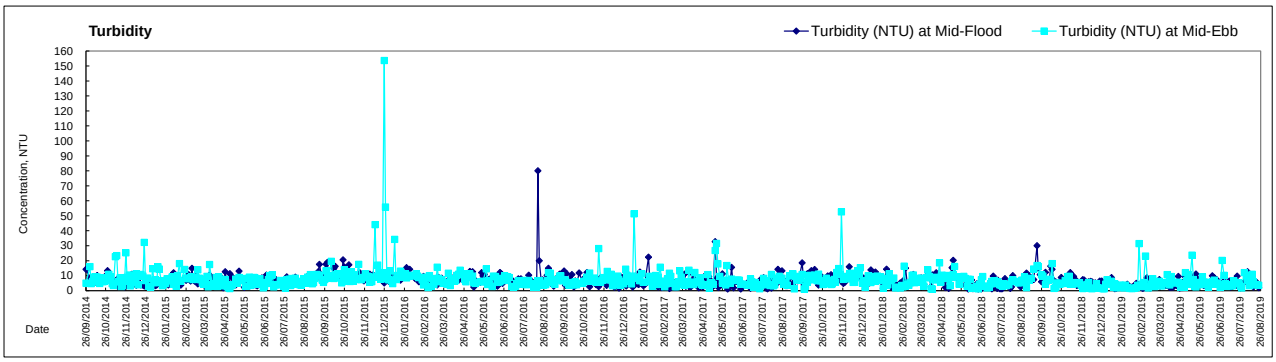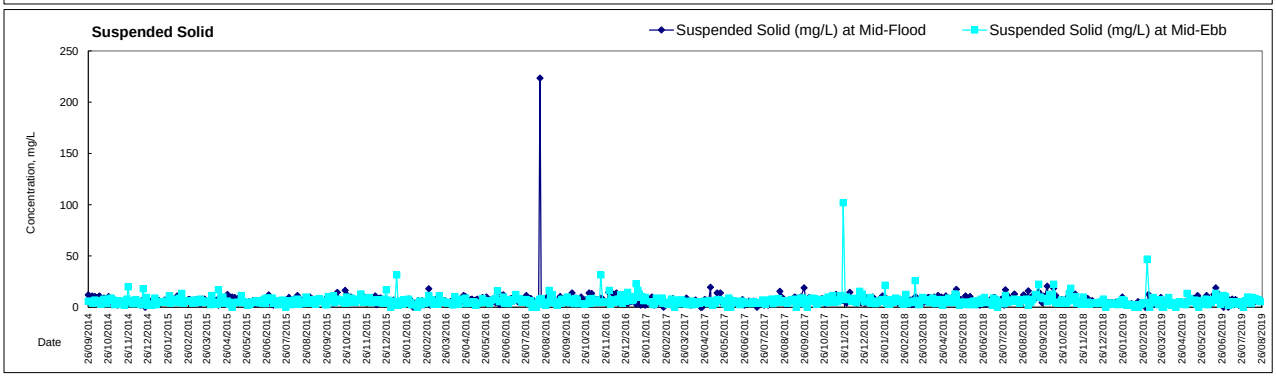
Graphic Presentation of Water Quality Result of Culvert J - Reference Station